



Powerseal, Romac, or approved equal
fusion bonded epoxy coated ductile iron
or stainless steel tapping sleeve.

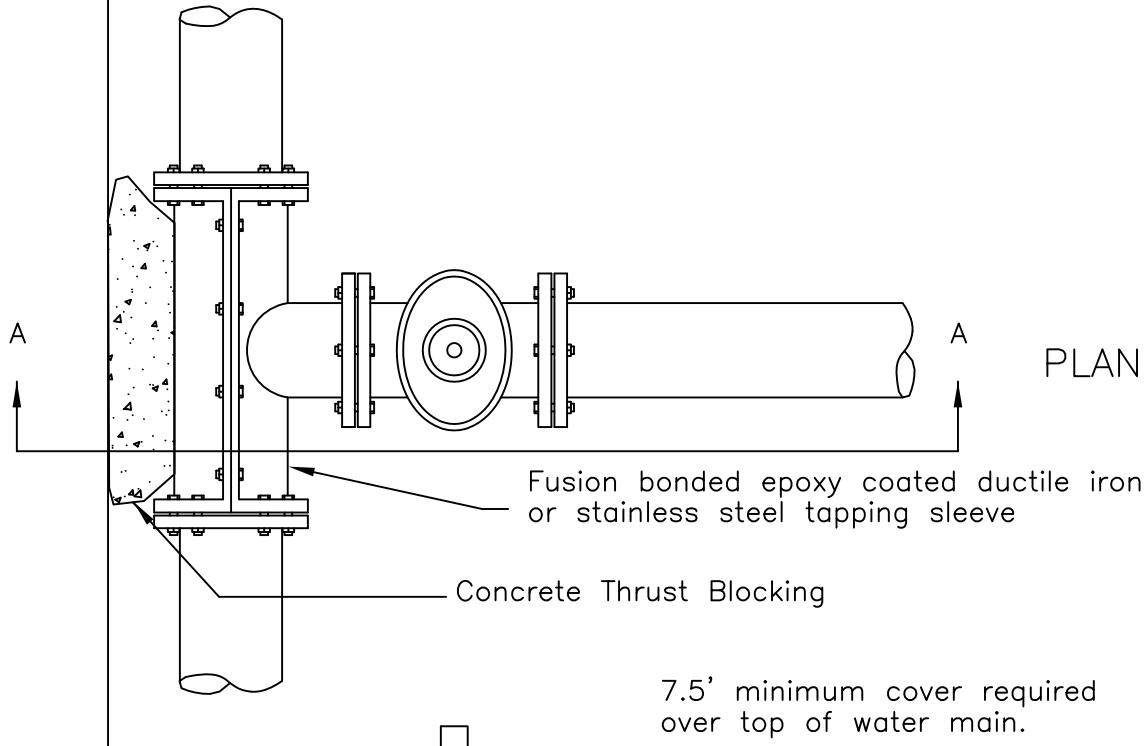

7.5' minimum cover required
over top of water main.

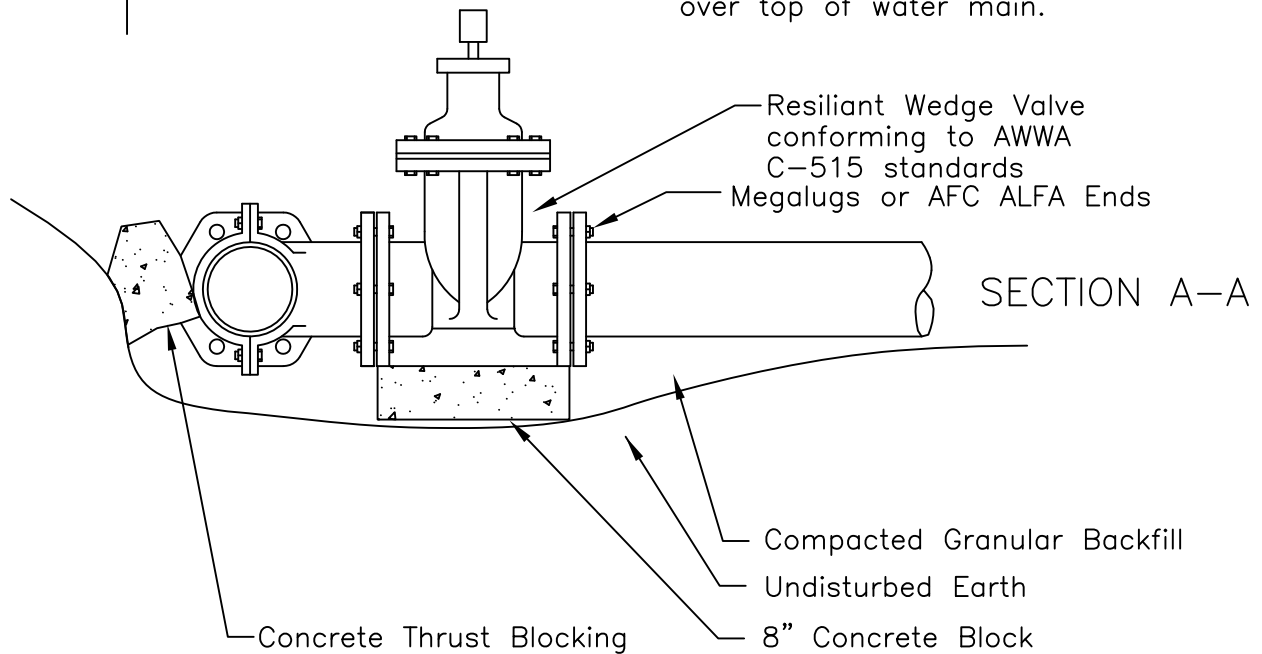

Note: All water main bolts shall be core-blue or approved equal.



STANDARD DETAILS
WATER MAIN WET TAP

Last Revision:
FEB 2017

City Plate No.
WAT-04
2017

FARMINGTON, MINNESOTA